

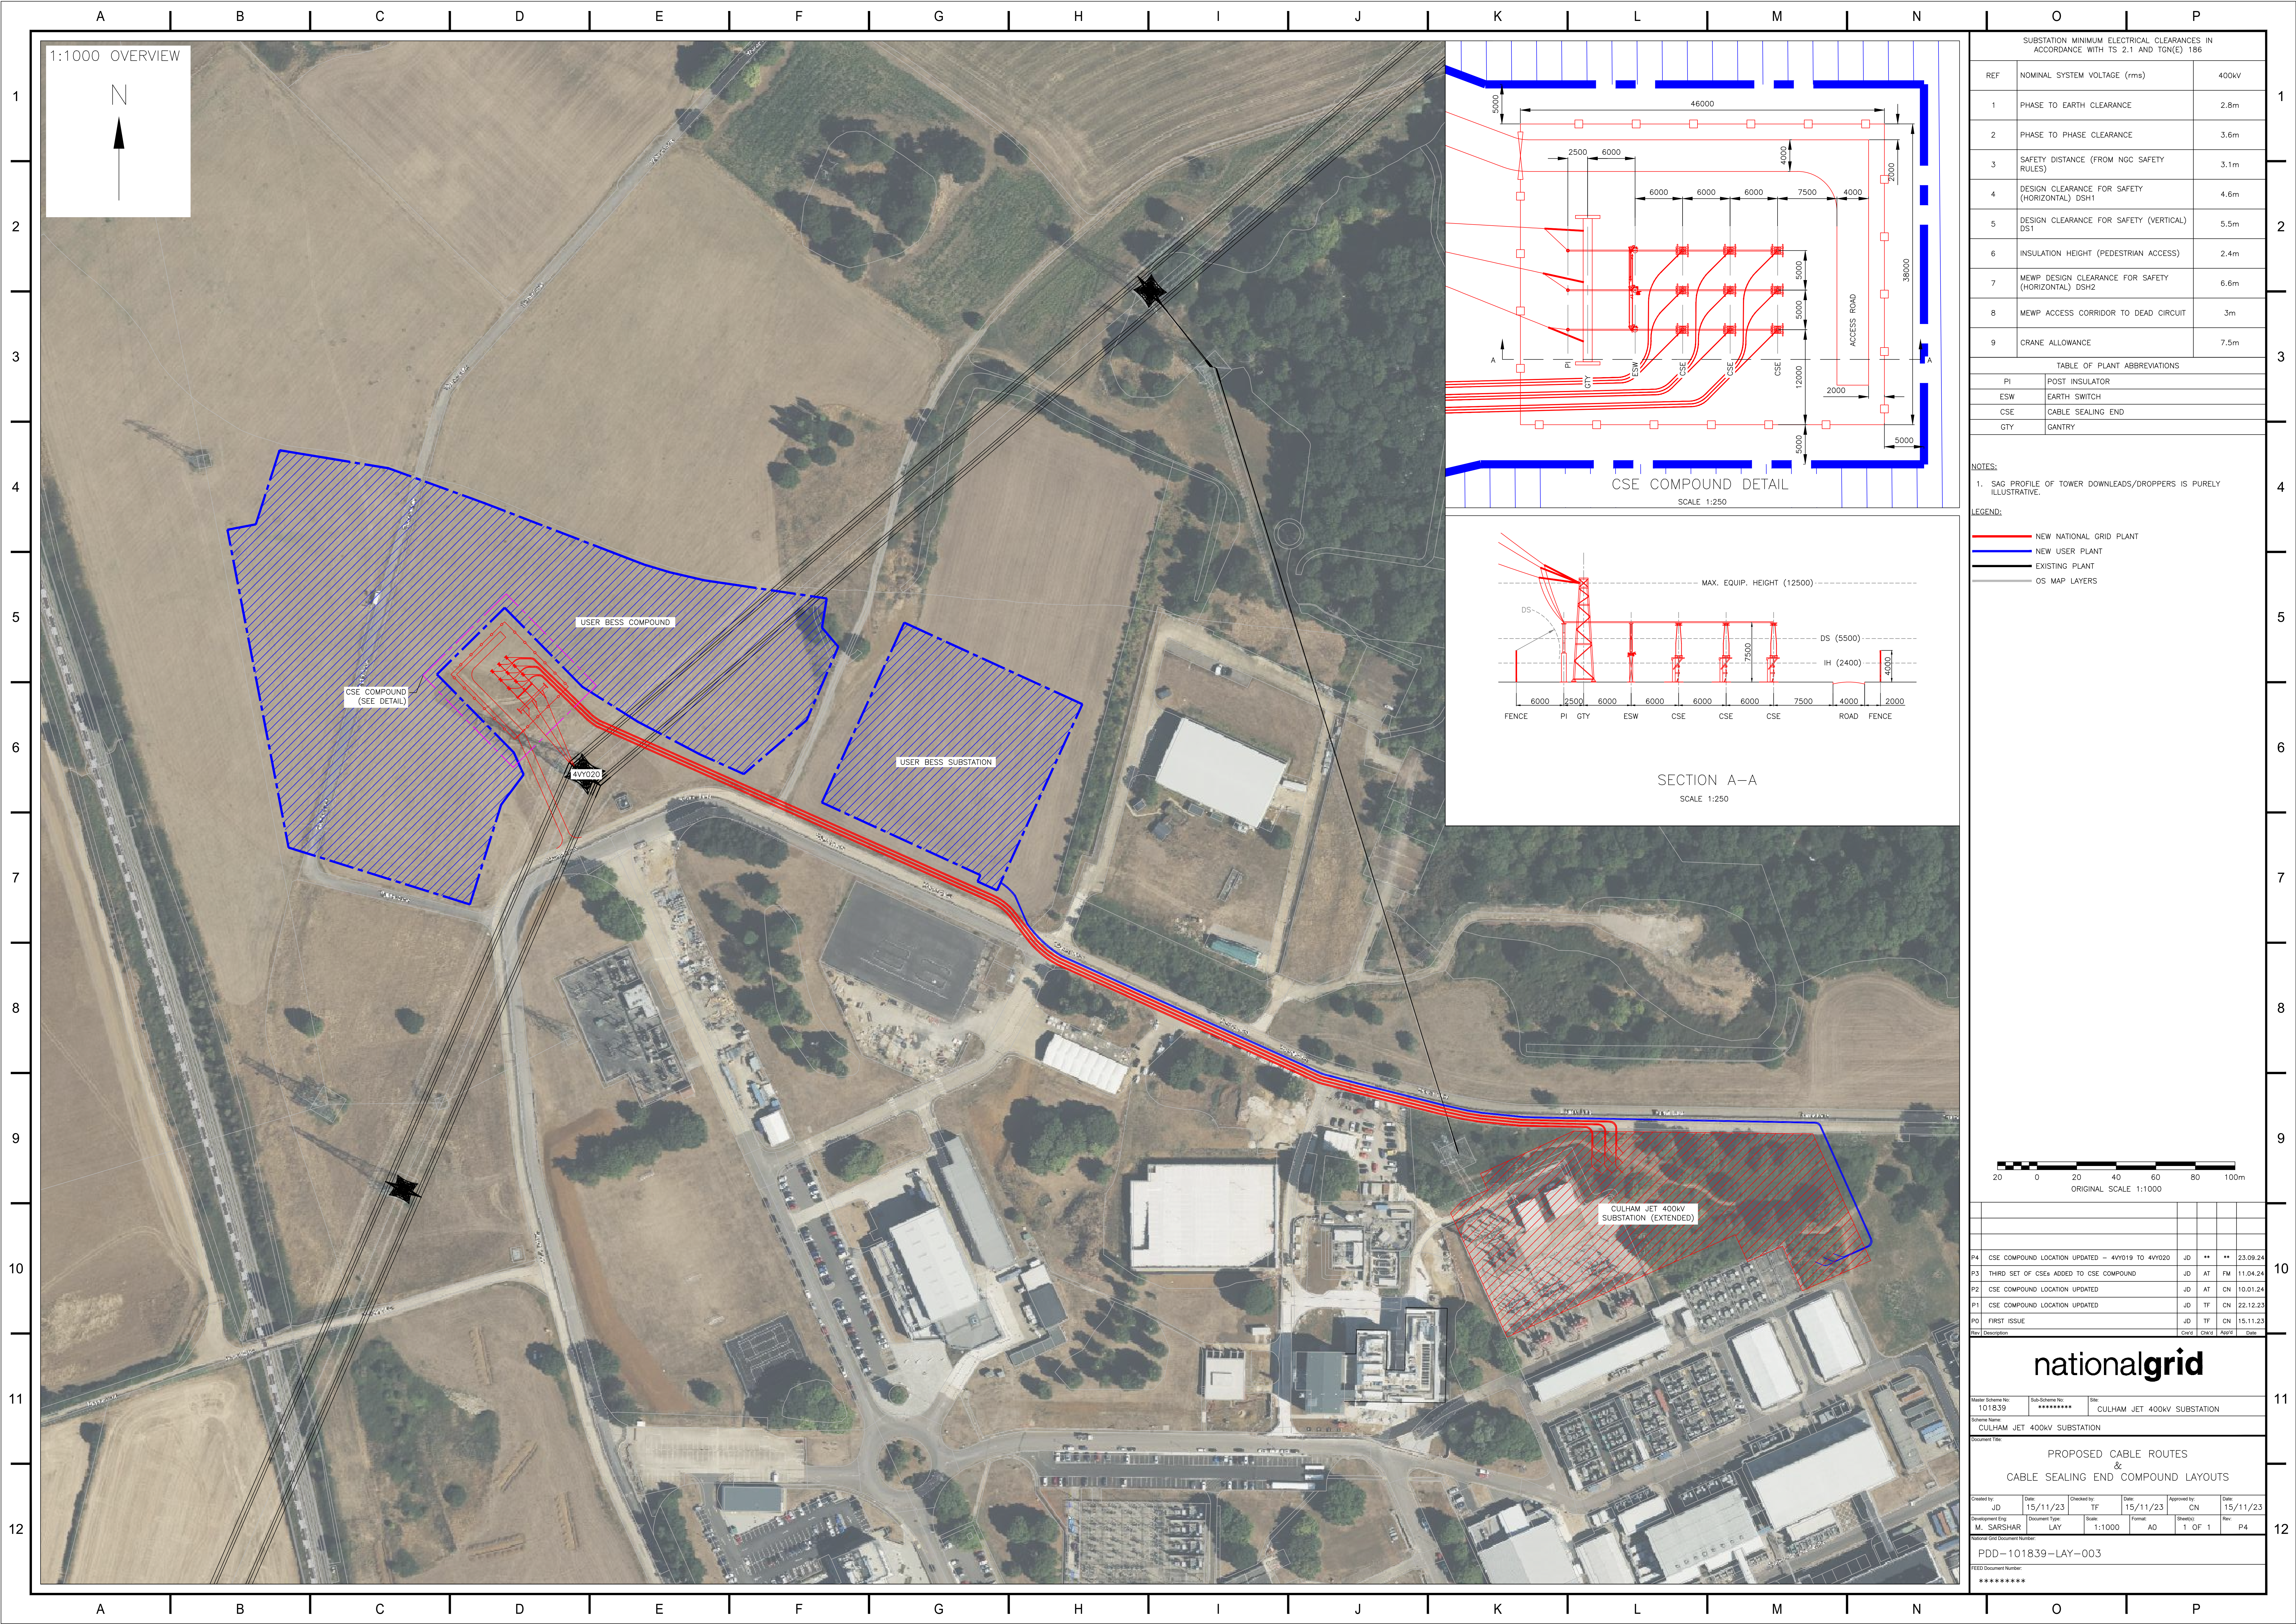


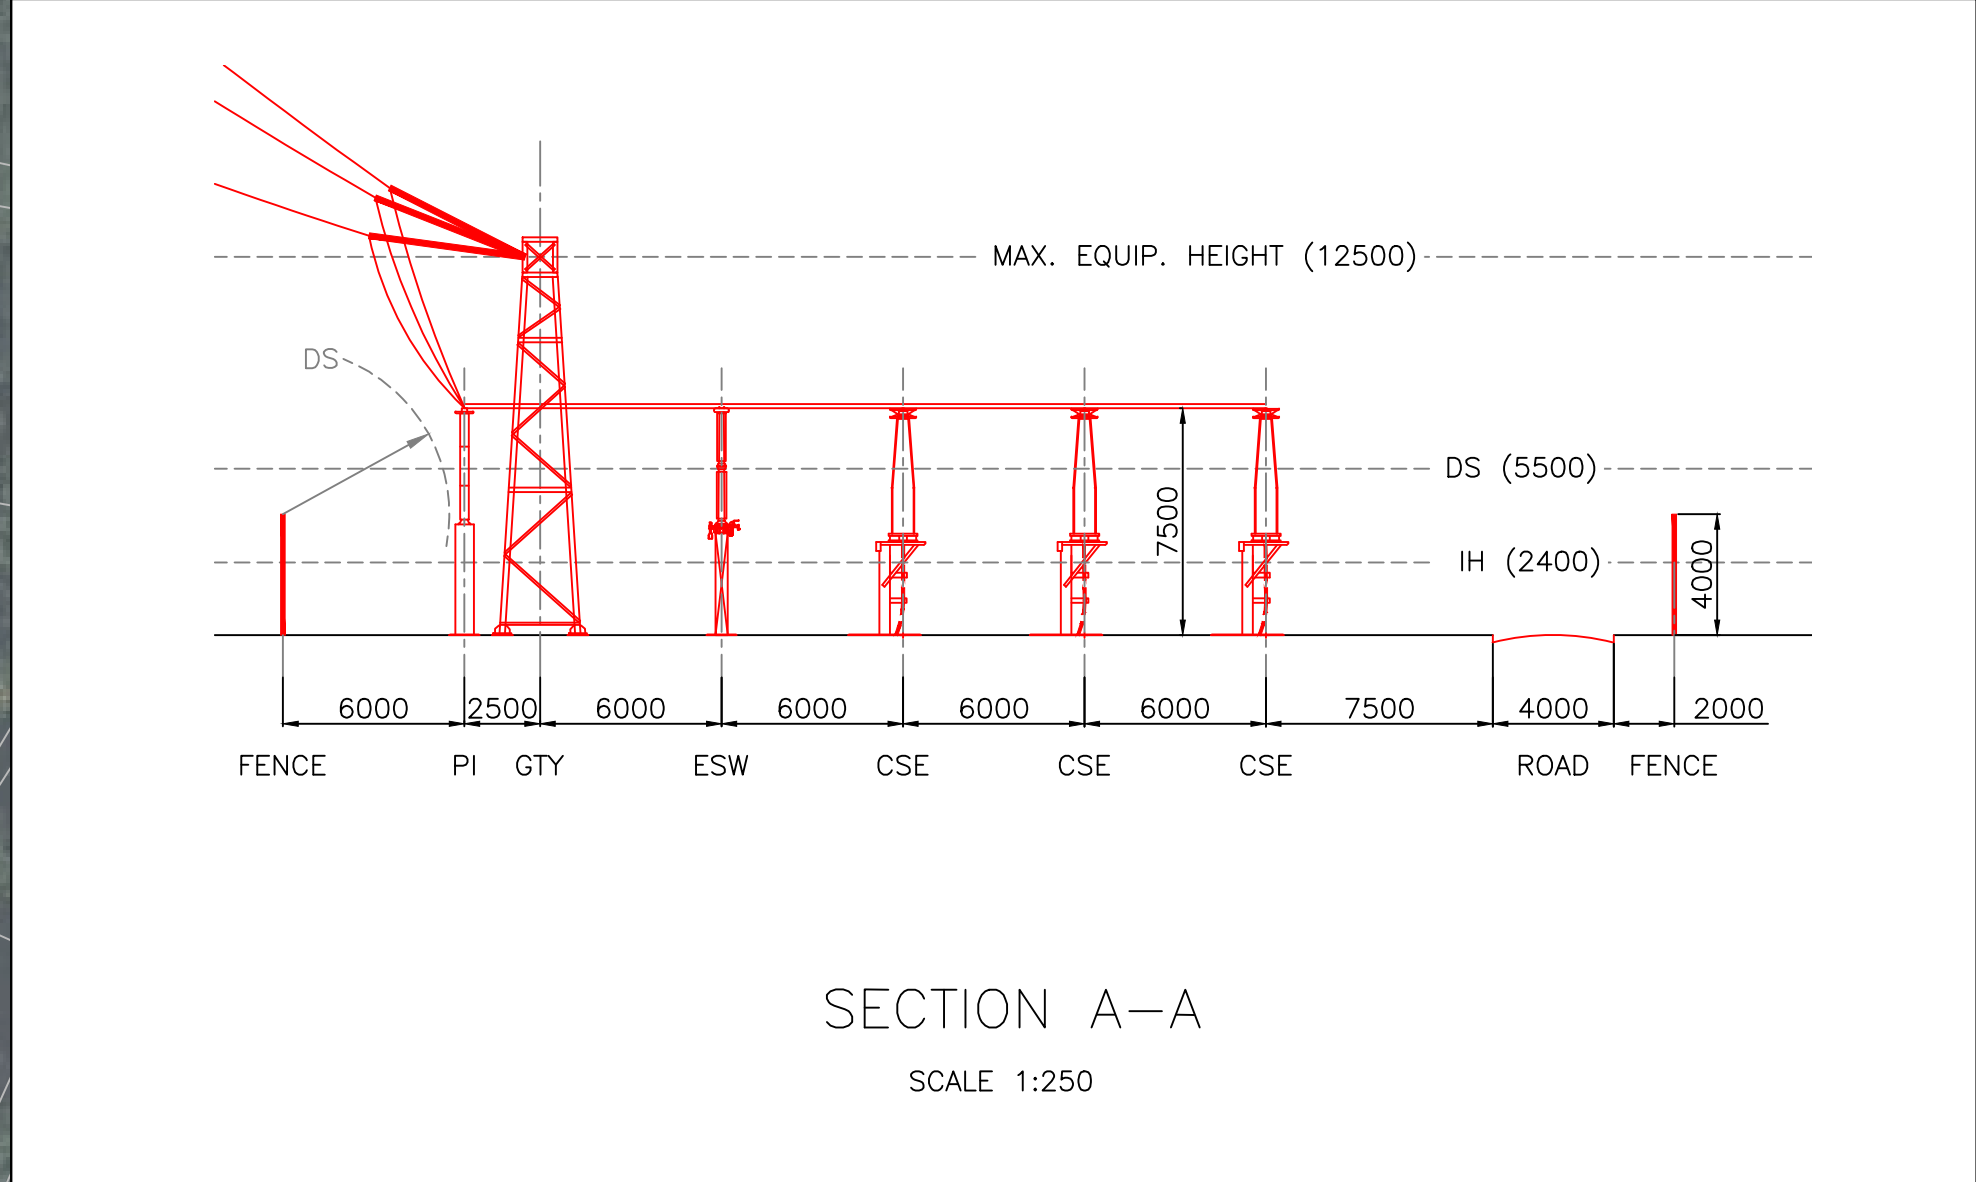

1:1000 OVERVIEW

N

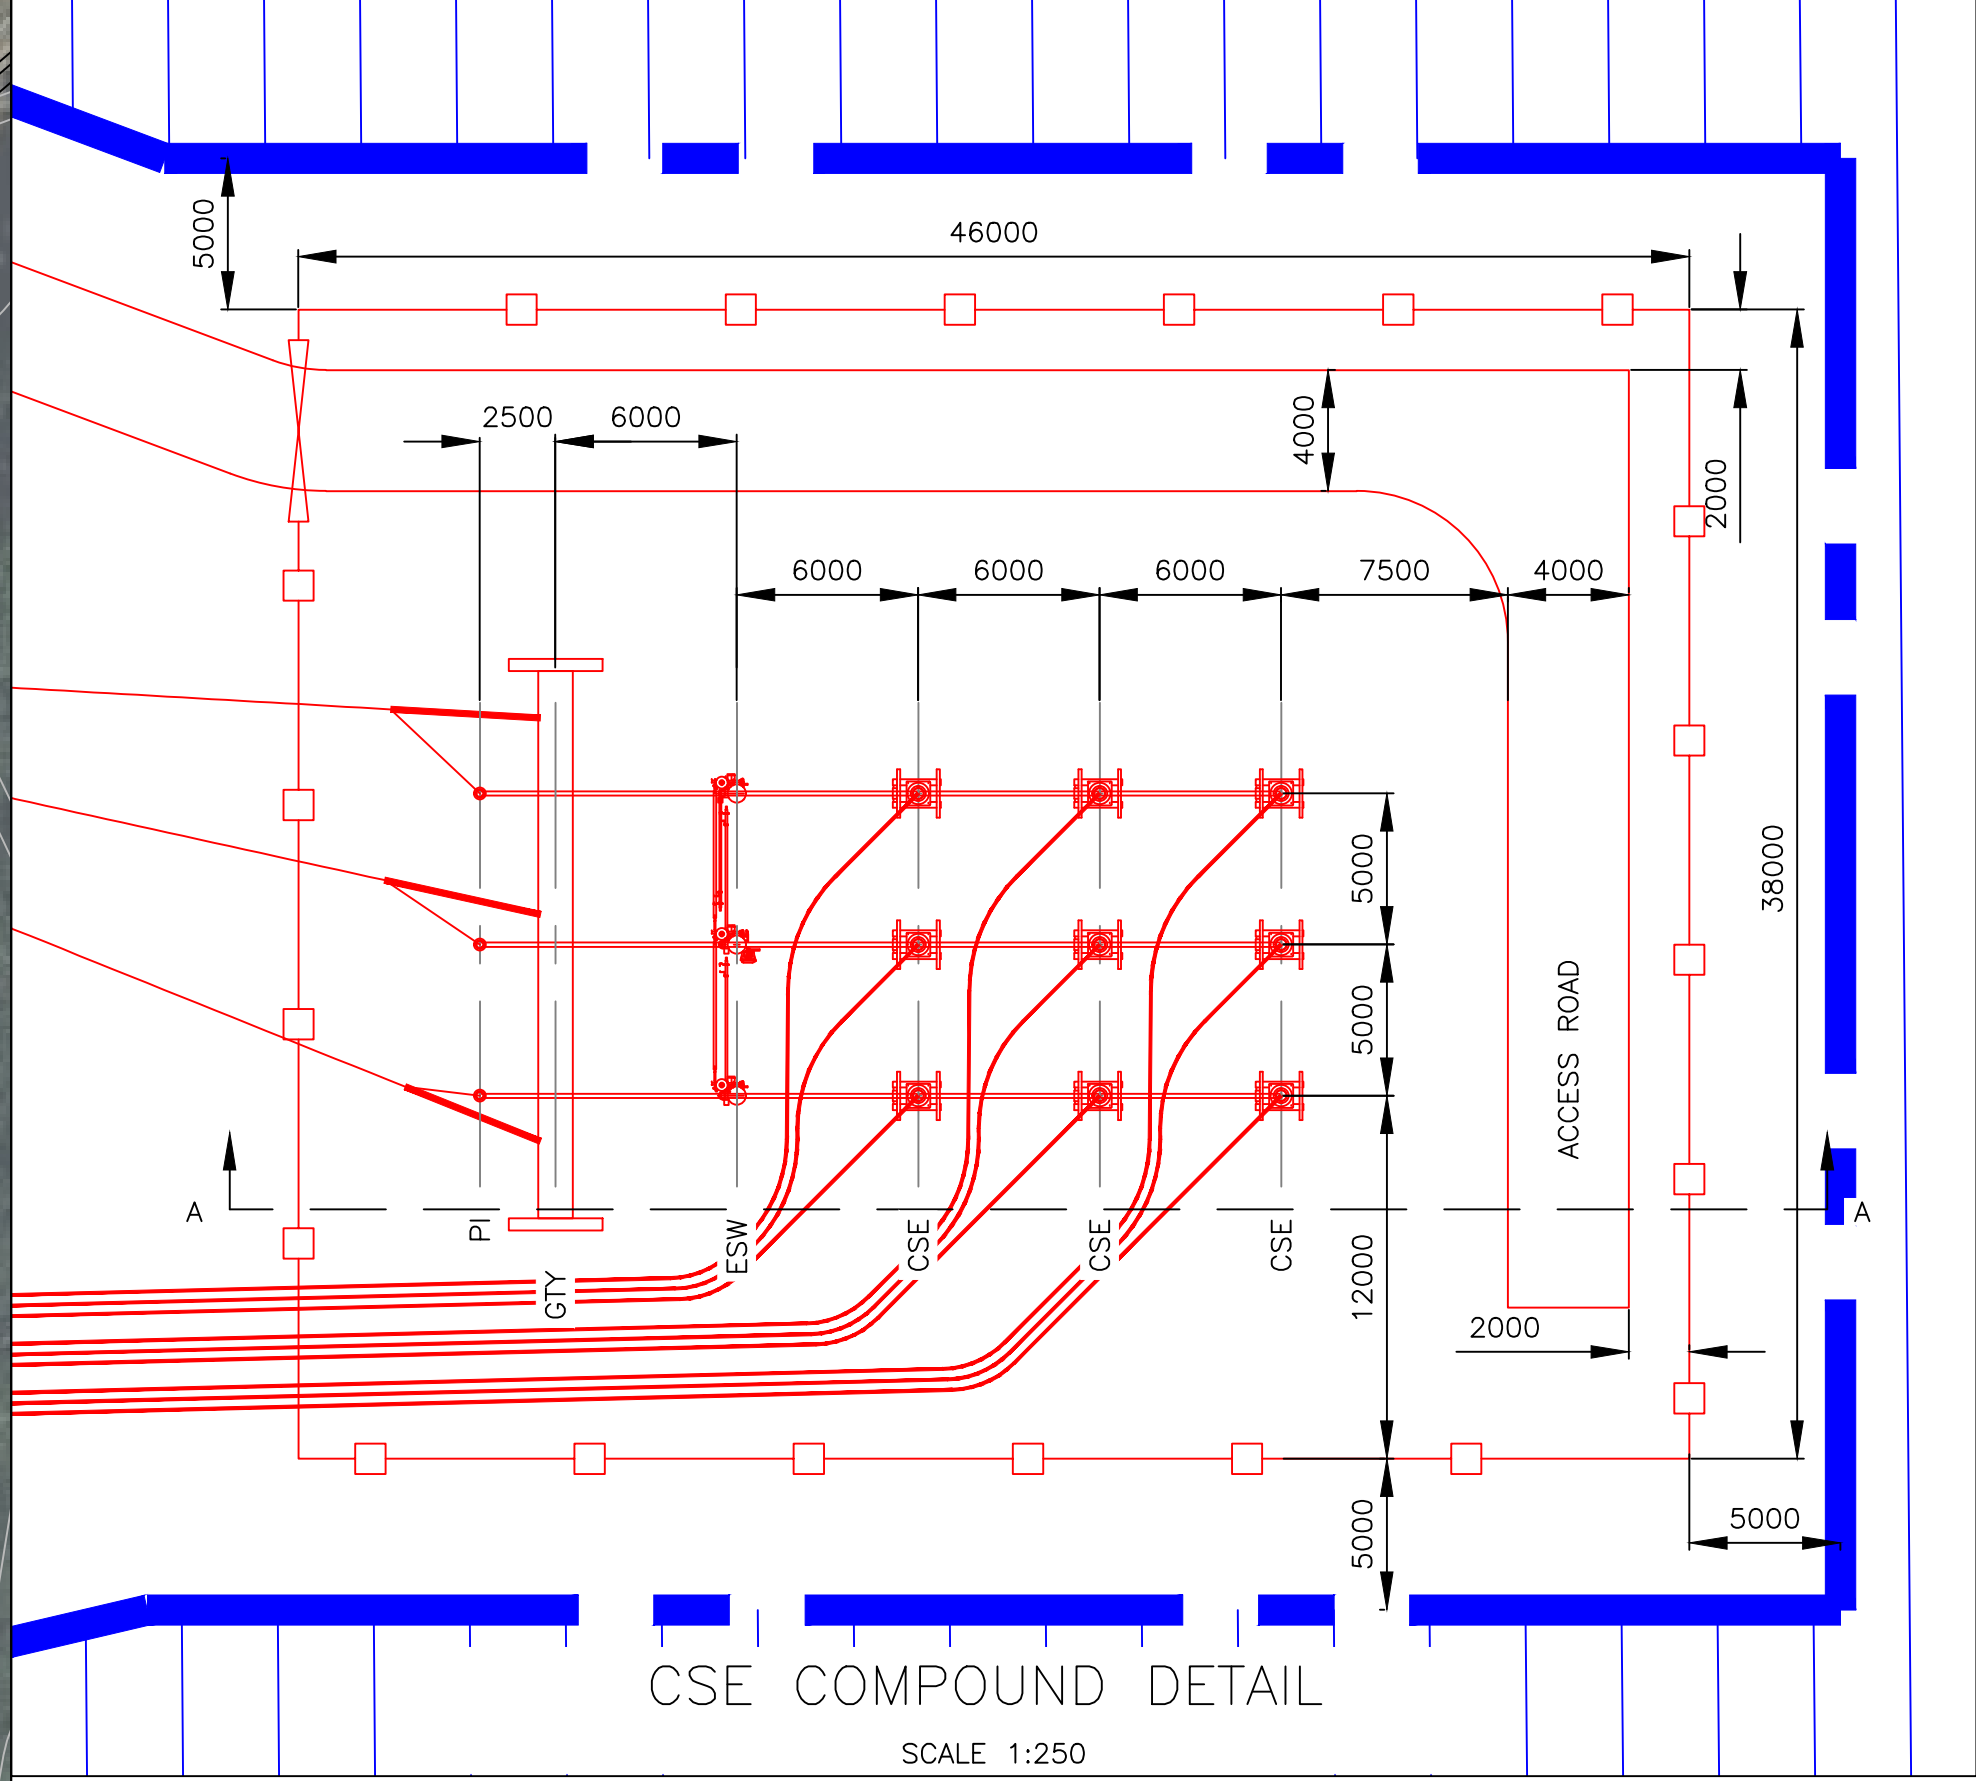


SUBSTATION MINIMUM ELECTRICAL CLEARANCES IN ACCORDANCE WITH TS 2.1 AND TGN(E) 186		
REF	NOMINAL SYSTEM VOLTAGE (rms)	400kV
1	PHASE TO EARTH CLEARANCE	2.8m
2	PHASE TO PHASE CLEARANCE	3.6m
3	SAFETY DISTANCE (FROM NGC SAFETY RULES)	3.1m
4	DESIGN CLEARANCE FOR SAFETY (HORIZONTAL) DSH1	4.6m
5	DESIGN CLEARANCE FOR SAFETY (VERTICAL) DS1	5.5m
6	INSULATION HEIGHT (PEDESTRIAN ACCESS)	2.4m
7	MEWP DESIGN CLEARANCE FOR SAFETY (HORIZONTAL) DSH2	6.6m
8	MEWP ACCESS CORRIDOR TO DEAD CIRCUIT	3m
9	CRANE ALLOWANCE	7.5m

TABLE OF PLANT ABBREVIATIONS	
PI	POST INSULATOR
ESW	EARTH SWITCH
CSE	CABLE SEALING END
GTY	GANTRY

NOTES:
1. SAG PROFILE OF TOWER DOWNLEADS/DROPPERS IS PURELY ILLUSTRATIVE.

- LEGEND:
- NEW NATIONAL GRID PLANT
 - NEW USER PLANT
 - EXISTING PLANT
 - OS MAP LAYERS

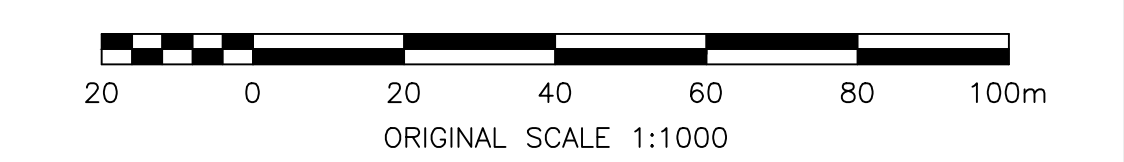

P4	CSE COMPOUND LOCATION UPDATED - 4YV019 TO 4YV020	JO	**	**	23.09.24
P3	THIRD SET OF CSEs ADDED TO CSE COMPOUND	JO	AT	FM	11.04.24
P2	CSE COMPOUND LOCATION UPDATED	JO	AT	CN	10.01.24
P1	CSE COMPOUND LOCATION UPDATED	JO	TF	CN	22.12.23
P0	FIRST ISSUE	JO	TF	CN	15.11.23
Rev	Description	Drawn	Checked	Approved	Date

nationalgrid

Master Scheme No: 101839 Sub-Scheme No: ***** Site: CULHAM JET 400kV SUBSTATION

Document Title: PROPOSED CABLE ROUTES & CABLE SEALING END COMPOUND LAYOUTS

Created by: JD	Date: 15/11/23	Checked by: TF	Date: 15/11/23	Approved by: CN	Date: 15/11/23
Drawn by: M. SARSHAR	Document Type: LAY	Scale: 1:1000	Format: A0	Drawings: 1 OF 1	Rev: P4

National Grid Document Number: PDD-101839-LAY-003

FEED Document Number: *****